


The Libertyville Fire Department

Rockland Fire District Monthly Report

Calls by Incident Type October, 2022

100's	Fire	
200's	Over Pressure. Rupture, Explosion, Overheat (no fire)	
300's	Rescue & Emergency Medical Calls	8
400's	Hazardous Condition (no fire)	1
500's	Service Call	
600's	Good Intent Call or Cancelled En Route	
700's	False Alarm & False Calls	1
800's	Severe Weather and/or Natural Disaster	
900's	Special Incident (see notes for details if applicable)	
October Total:		10


Calls by Incident Type Oct, 2022

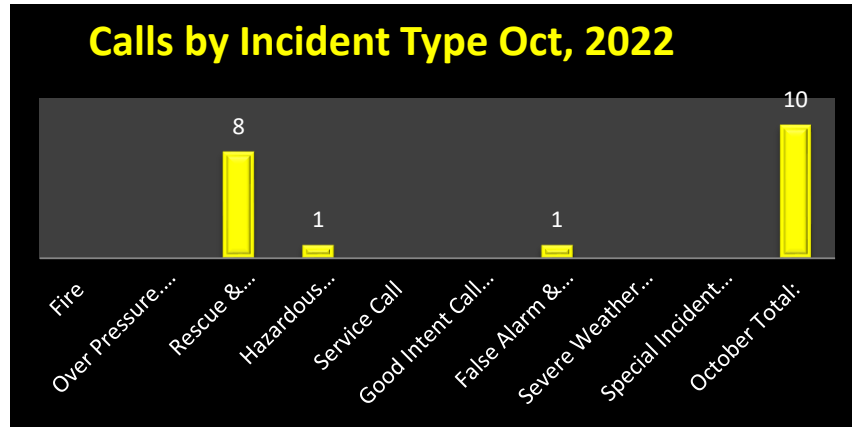

Calls by Incident Type YTD (2022)

100's	Fire	
200's	Over Pressure. Rupture, Explosion, Overheat (no fire)	
300's	Rescue & Emergency Medical Calls	54
400's	Hazardous Condition (no fire)	2
500's	Service Call	5
600's	Good Intent Call or Cancelled En Route	
700's	False Alarm & False Calls	3
800's	Severe Weather and/or Natural Disaster	
900's	Special Incident (see notes for details if applicable)	
YTD Total:		64

Calls by Incident Type YTD, 2022

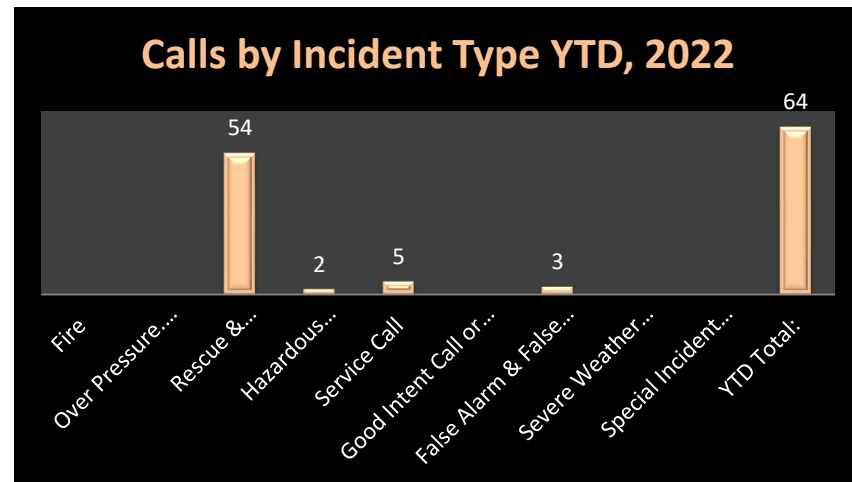

Mutual Aid to Lake Forest Fire in District 42K October, 2022

100's	Fire	0
300's	Rescue & Emergency Medical Calls	1
600's	Good Intent Call or Cancelled En Route	
October Total:		1

Mutual Aid to Lake Forest Fire in District 42K YTD (2022)

100's	Fire	1
300's	Rescue & Emergency Medical Calls	11
600's	Good Intent Call or Cancelled En Route	1
YTD Total:		13

Notes:

Average Emergent Resonse Time (October)
from Alarm to Arrival = 04:59

Average Emergent Resonse Time (2022)
from Alarm to Arrival = 04:32

Note: Response time is from tone out time to time on location

LFD, Rockland Response Time Report

October, 2022

Incident Date	Incident Number	District	Alarm Received	Alarm Dispatched	En Route Time	Arrival Time	Apparatus Name	Priority	Incident Type	Total Response Time
8/2/2022	22-3634	46K	2:55:11 PM	2:55:56 PM	2:56:42 PM	3:01:08 PM	B46, A461, NCA	E	EMS	0:05:12
8/14/2022	22-3638	46K	6:47:47 PM	6:48:31 PM	6:49:23 PM	6:52:44 PM	A463	E	EMS	0:04:13
8/19/2022	22-3646	46K	10:12:27 AM	10:13:10 AM	10:14:00 AM	10:16:42 AM	A463	E	EMS	0:03:32
8/24/2022	22-3700	46K	8:30:59 AM	8:31:41 AM	8:32:26 AM	8:35:35 AM	A463	E	EMS	0:03:54
8/31/2022	22-3737	46K	4:25:55 PM	4:26:57 PM	4:28:00 PM	4:30:35 PM	A463	E	EMS	0:03:38
	22-3741	46K	8:30:59 PM	8:32:09 PM	8:34:12 PM	8:36:34 PM	NCE152	E	CO Alarm Activaton	0:04:25
	22-3845	46K	10:27:11 AM	10:27:53 AM	10:28:40 AM	10:37:13 AM	A463	E	EMS	0:09:20
	22-3849	46K	1:42:08 PM	1:43:56 PM	1:45:57 PM	1:47:47 PM	E463	E	Gas Leak	0:03:51
	22-3875	46K	9:42:41 AM	9:44:49 AM	9:45:14 AM	9:53:20 AM	A461	E	EMS	0:08:31
	22-3998	46K	5:50:18 PM	5:50:57 PM	5:51:51 PM	5:54:08 PM	A463	E	EMS	0:03:11

Average Emergent Response Time: 0:04:59